


THIS DETAIL DRAWING SHALL NOT BE ALTERED OR CHANGED IN ANY MANNER EXCEPT BY THE CITY ENGINEER. IT IS THE RESPONSIBILITY OF THE USER TO ACQUIRE THE MOST CURRENT VERSION OF THE DETAIL.

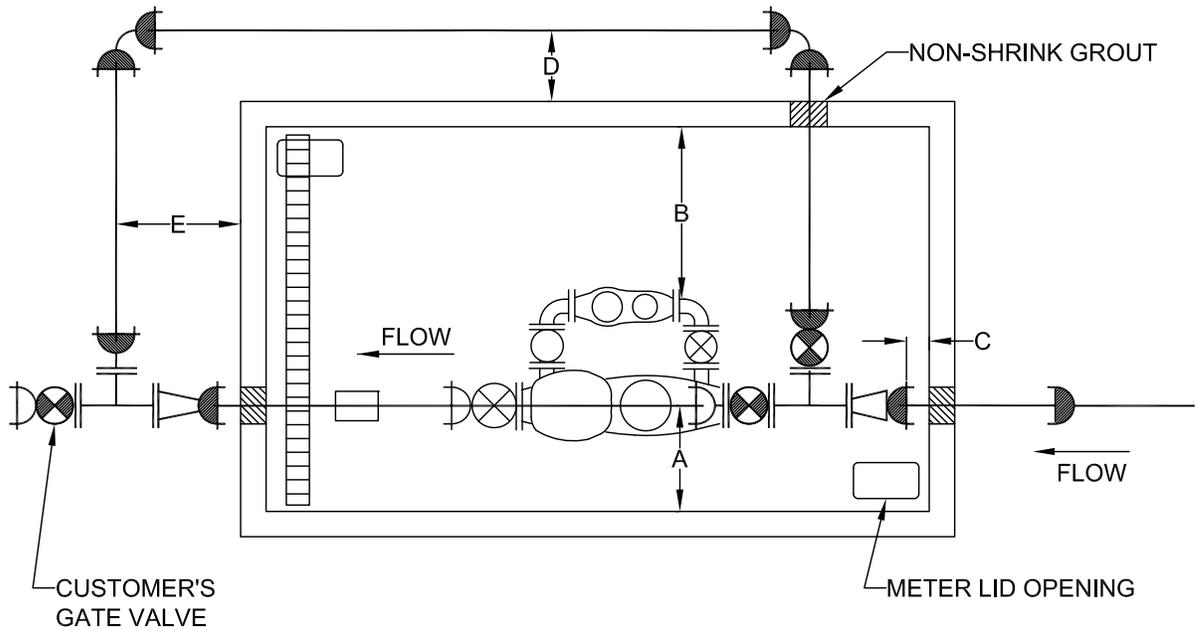

METER	4 x 2	6 x 3	8 x 4	3" COMPOUND
INCOMING LINE SIZE	6"	8"	10"	4"
BY-PASS LINE SIZE	4"	4"	6"	2" CU
UTILITY VAULT NO.	810-LA	712-LA	814-LA	687-LA
A	24"	18"	18"	24"
B	36"	36"	36"	24"
C	12"	12"	12"	12"
D	24"	24"	26"	24"
E	24"	28"	30"	24"

- MECHANICAL JOINT WITH MEGALUG RETAINER GLAND (1100 SERIES)
- PIPE BELL WITH MEGALUG HARNESS (1100HD SERIES)

**STANDARD HERSEY
MFM-MCT COMPOUND
METER INSTALLATIONS
4x2, 6x3, 8x4, 3"**

<p style="font-size: 24px; font-weight: bold; margin: 0;">West Linn</p>	DATE: 2010
	DRAWING NO. WL-413A
	FILE NO.