
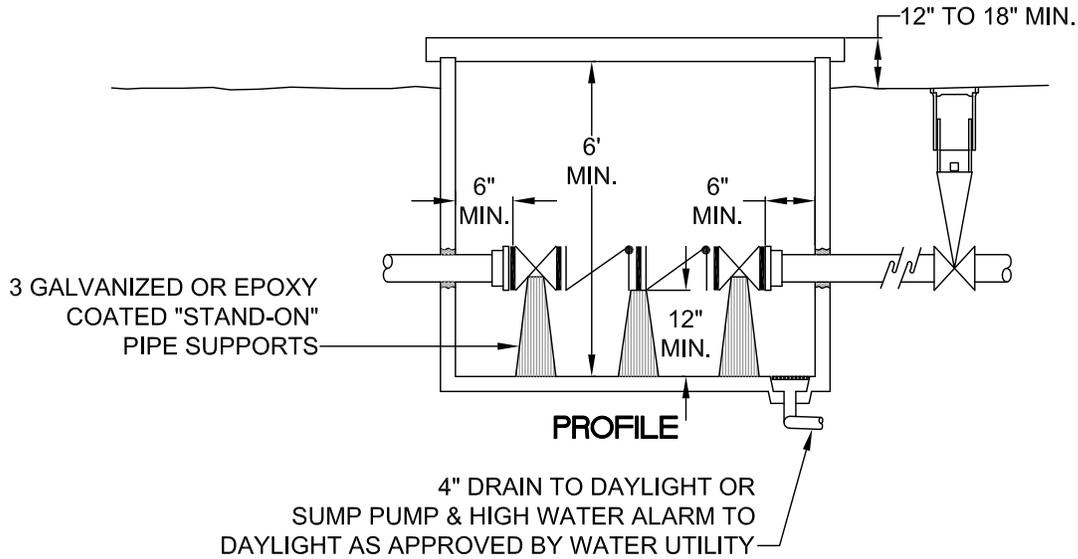


THIS DETAIL DRAWING SHALL NOT BE ALTERED OR CHANGED IN ANY MANNER EXCEPT BY THE CITY ENGINEER. IT IS THE RESPONSIBILITY OF THE USER TO ACQUIRE THE MOST CURRENT VERSION OF THE DETAIL.

NO OTHER DEVICES SHALL BE INSTALLED IN D.D.C. VAULT.

LOCAL FIRE DEPT. AND PLUMBING CODE REQUIREMENTS APPLY TO ALL WATER FACILITIES PAST THE BACKFLOW VAULT.

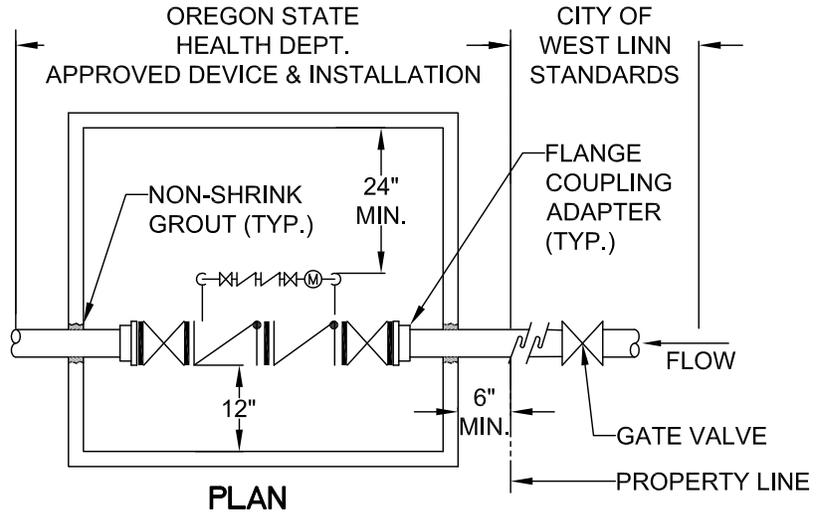

D.D.C. SIZE	UTILITY VAULT for DOUBLE DETECTOR CHECK DEVICE	
	VAULT	LID
3"	577-LA	LID 577-TL2-332P
4"	577-LA	LID 577-TL2-332P
6"	676-LA	LID 676-TL2-332P
8"	687-LA	LID 687-TL2-332P
10"	5106-LA	LID 5106-TL3-332P

## DOUBLE DETECTOR CHECK VAULT

	DATE: 2010
	DRAWING NO. WL-414A
	FILE NO.