




THIS DETAIL DRAWING SHALL NOT BE ALTERED OR CHANGED IN ANY MANNER EXCEPT BY THE CITY ENGINEER. IT IS THE RESPONSIBILITY OF THE USER TO ACQUIRE THE MOST CURRENT VERSION OF THE DETAIL.

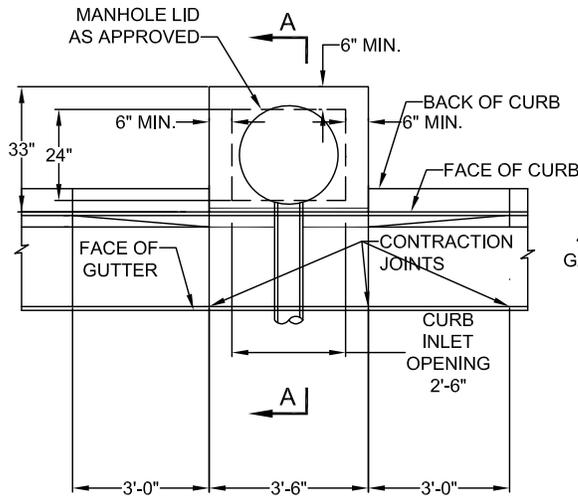


PLAN VIEW

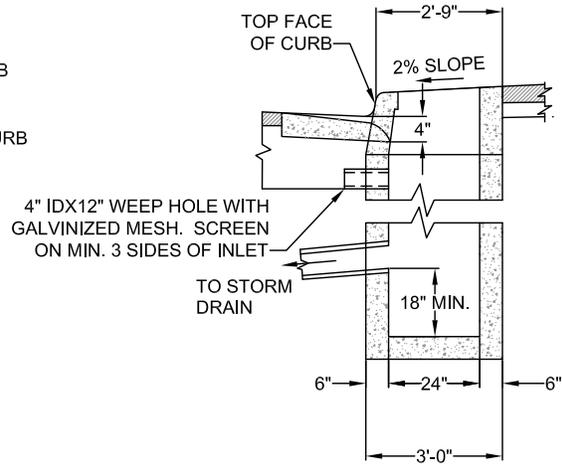

SECTION A-A

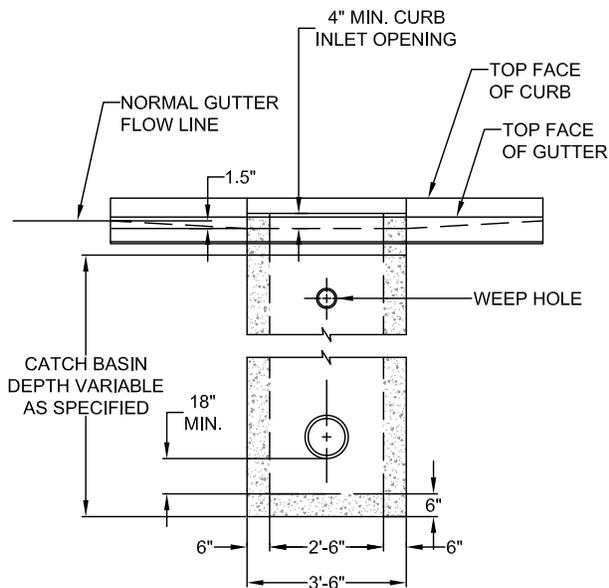

FRONT VIEW

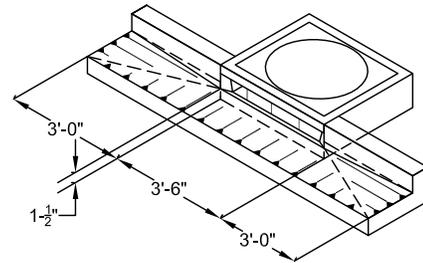

**PERSPECTIVE VIEW SHOWING
DEPRESSED GUTTER AT CURB INLET**

NOTE:

1. ALL FABRICATED METAL PARTS SHALL BE HOT-DIPPED GALVANIZED AFTER FABRICATION.
2. CONCRETE STRENGTH SHALL BE 3300 PSI AT 28 DAYS.
3. CURB INLET BASE MAY BE PRECAST OR CAST-IN-PLACE.
4. FOR SLOPES OF 5% OR GREATER, USE DWG. WL-601.

**GUTTER INLET
2 1/2 A**



CITY OF
**West
Linn**

DATE: 2010
DRAWING NO. WL-600
FILE NO.