
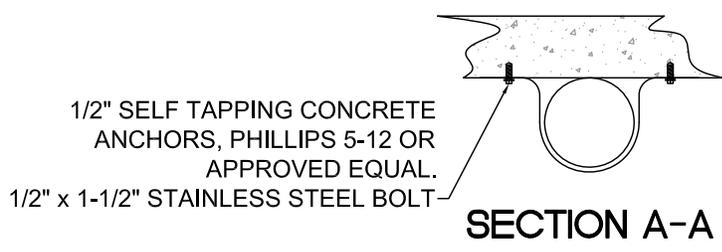


THIS DETAIL DRAWING SHALL NOT BE ALTERED OR CHANGED IN ANY MANNER EXCEPT BY THE CITY ENGINEER. IT IS THE RESPONSIBILITY OF THE USER TO ACQUIRE THE MOST CURRENT VERSION OF THE DETAIL.

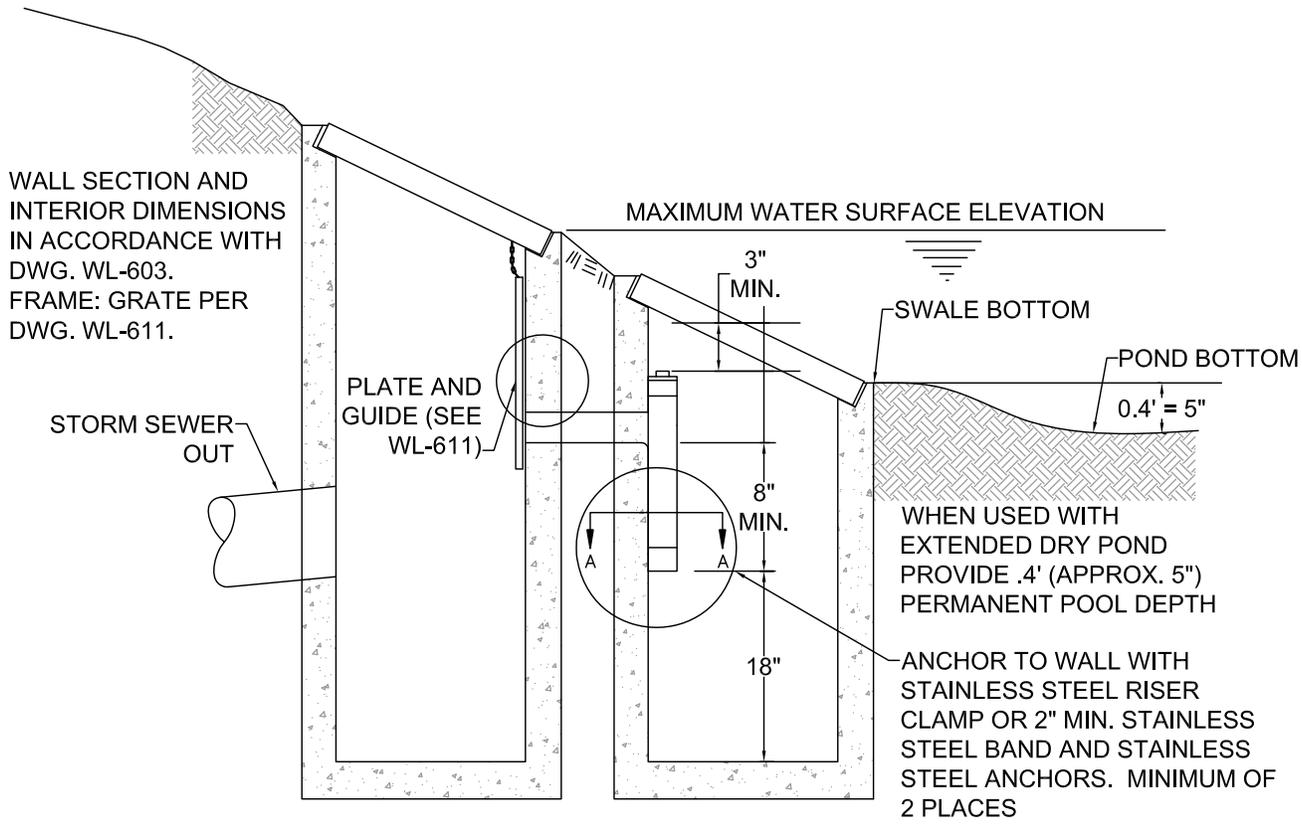

- NOTE:**
1. CONNECTING PIPE AND TEE SHALL BE 4", 6", OR 8" AWWA C-900 OR ASTM 3034 PVC, AND ONE SIZE LARGER THAN THE ORIFICE OPENING.
 2. MAXIMUM ORIFICE OPENING SHALL BE 6" DIAMETER.
 3. STRUCTURES SHALL CONFORM TO STANDARD DRAWING NO. 390 DITCH INLET.
 4. FRAME AND GRATE SHALL CONFORM TO STANDARD DRAWING NO. 400, DITCH INLET FRAME AND GRATE.
 5. PLATE AND GUIDE SHALL BE SECURED FLUSH AGAINST WALL OF STRUCTURE AS APPROVED.
 6. MAINTAINANCE ACCESS REQUIRED TO WITHIN 10' OF CENTER OF BOTH STRUCTURES.

STANDARD DETENTION POND OUTLET	
	DATE: 2010
	DRAWING NO. WL-610
	FILE NO.