
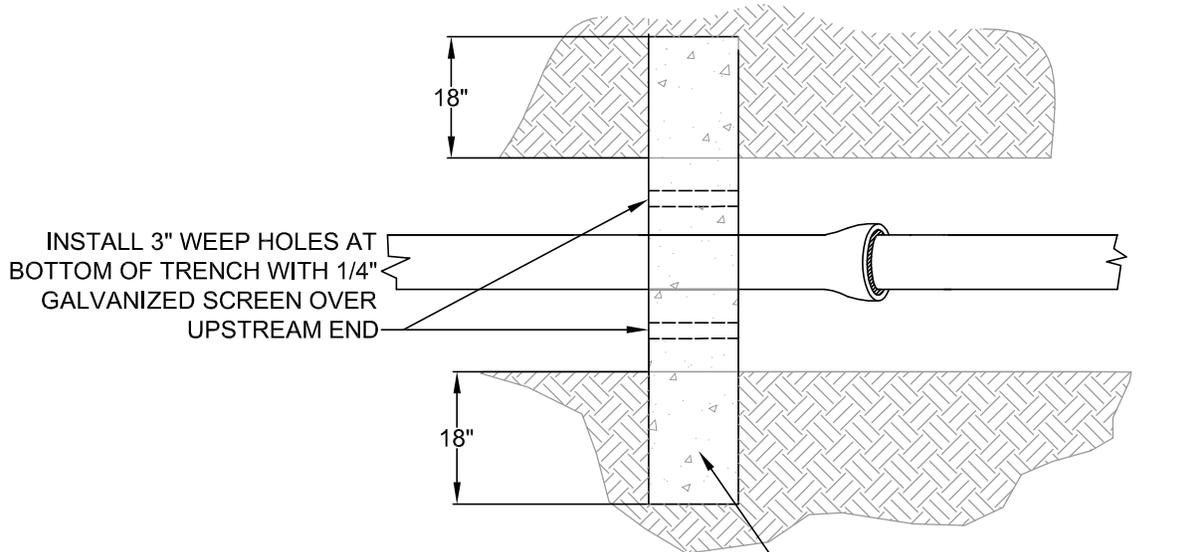


THIS DETAIL DRAWING SHALL NOT BE ALTERED OR CHANGED IN ANY MANNER EXCEPT BY THE CITY ENGINEER. IT IS THE RESPONSIBILITY OF THE USER TO ACQUIRE THE MOST CURRENT VERSION OF THE DETAIL.

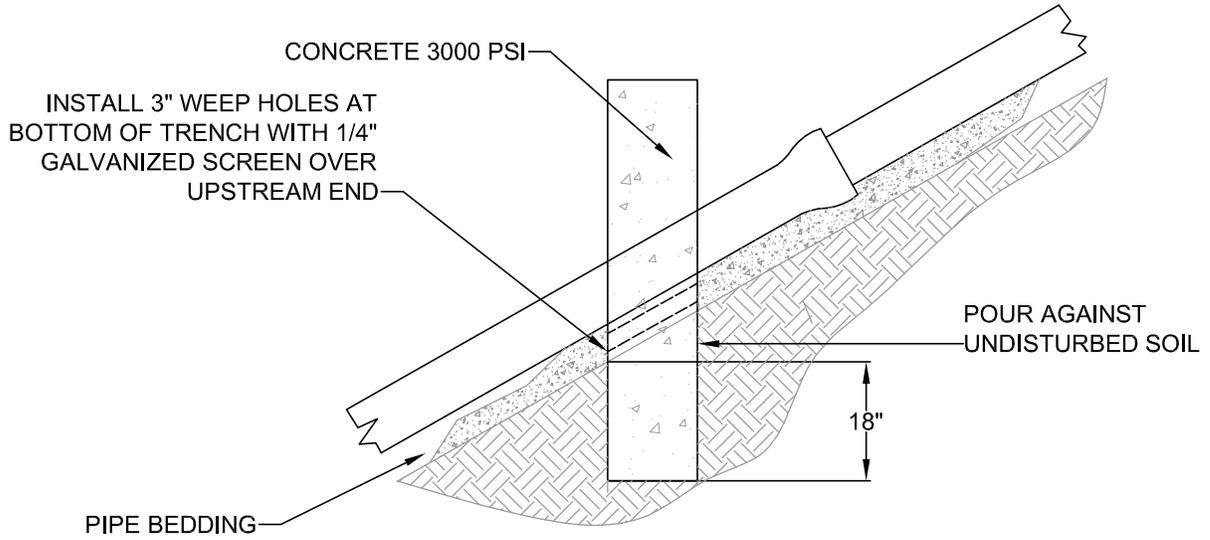

NOTE:

1. CONCRETE ANCHOR WALLS (3000 PSI) SHALL BE CONSTRUCTED USING FORMS WHEN SLOPES ARE 20% OR GREATER.
2. REMOVE FORMS PRIOR TO BACKFILLING TRENCH.

POUR BOTH SIDES AGAINST UNDISTURBED SOIL

SLOPE	MIN. ANCHOR SPACING CENTER TO CENTER
0.20 - 0.34	35'
0.35 - 0.50	25'
0.51+	CONC. 15' OR ENCASEMENT

ANCHOR WALL



CITY OF
**West
Linn**

DATE: 2010

DRAWING NO.
WL-205A

FILE NO.