LEGEND

Symbol	QTY	Part No.	TORO PRODUCTS DESCRIPTION
	9	626-00-24	ADJUSTABLE PART CIRCLE SPRINKLER 5.6GPM
	49	626-00-25	ADJUSTABLE PART CIRCLE SPRINKLER 5.6GPM
	10	626-00-26	ADJUSTABLE PART CIRCLE SPRINKLER 7.9GPM
	5	624-00-26	FULL CIRCLE SPRINKLER 9.0GPM
	13	570-HP-18	12" POP-UP SHRUB HEADS 15' radius
	29	570-HP-12	12" POP-UP SHRUB HEADS 12' radius
	23	570-P-12	3" POP-UP LAWN HEADS 12' radius
	1	126-01-11	CUSTOM 11 NORMALLY OPEN CONTROLLER
	1	- - -	FEBCO 1½" PRESSURE VACUUM BREAKER
	1	- - -	WATTS 1½" PRESSURE REDUCER
	1	- - -	2" gate valve for main shutoff
	1	- - -	QUICK CONNECT FOR AIR COMPRESSOR
	8	232-01-06	1½" NORMALLY OPEN HYDRAULIC VALVE
	3	232-01-04	1" NORMALLY OPEN HYDRAULIC VALVE

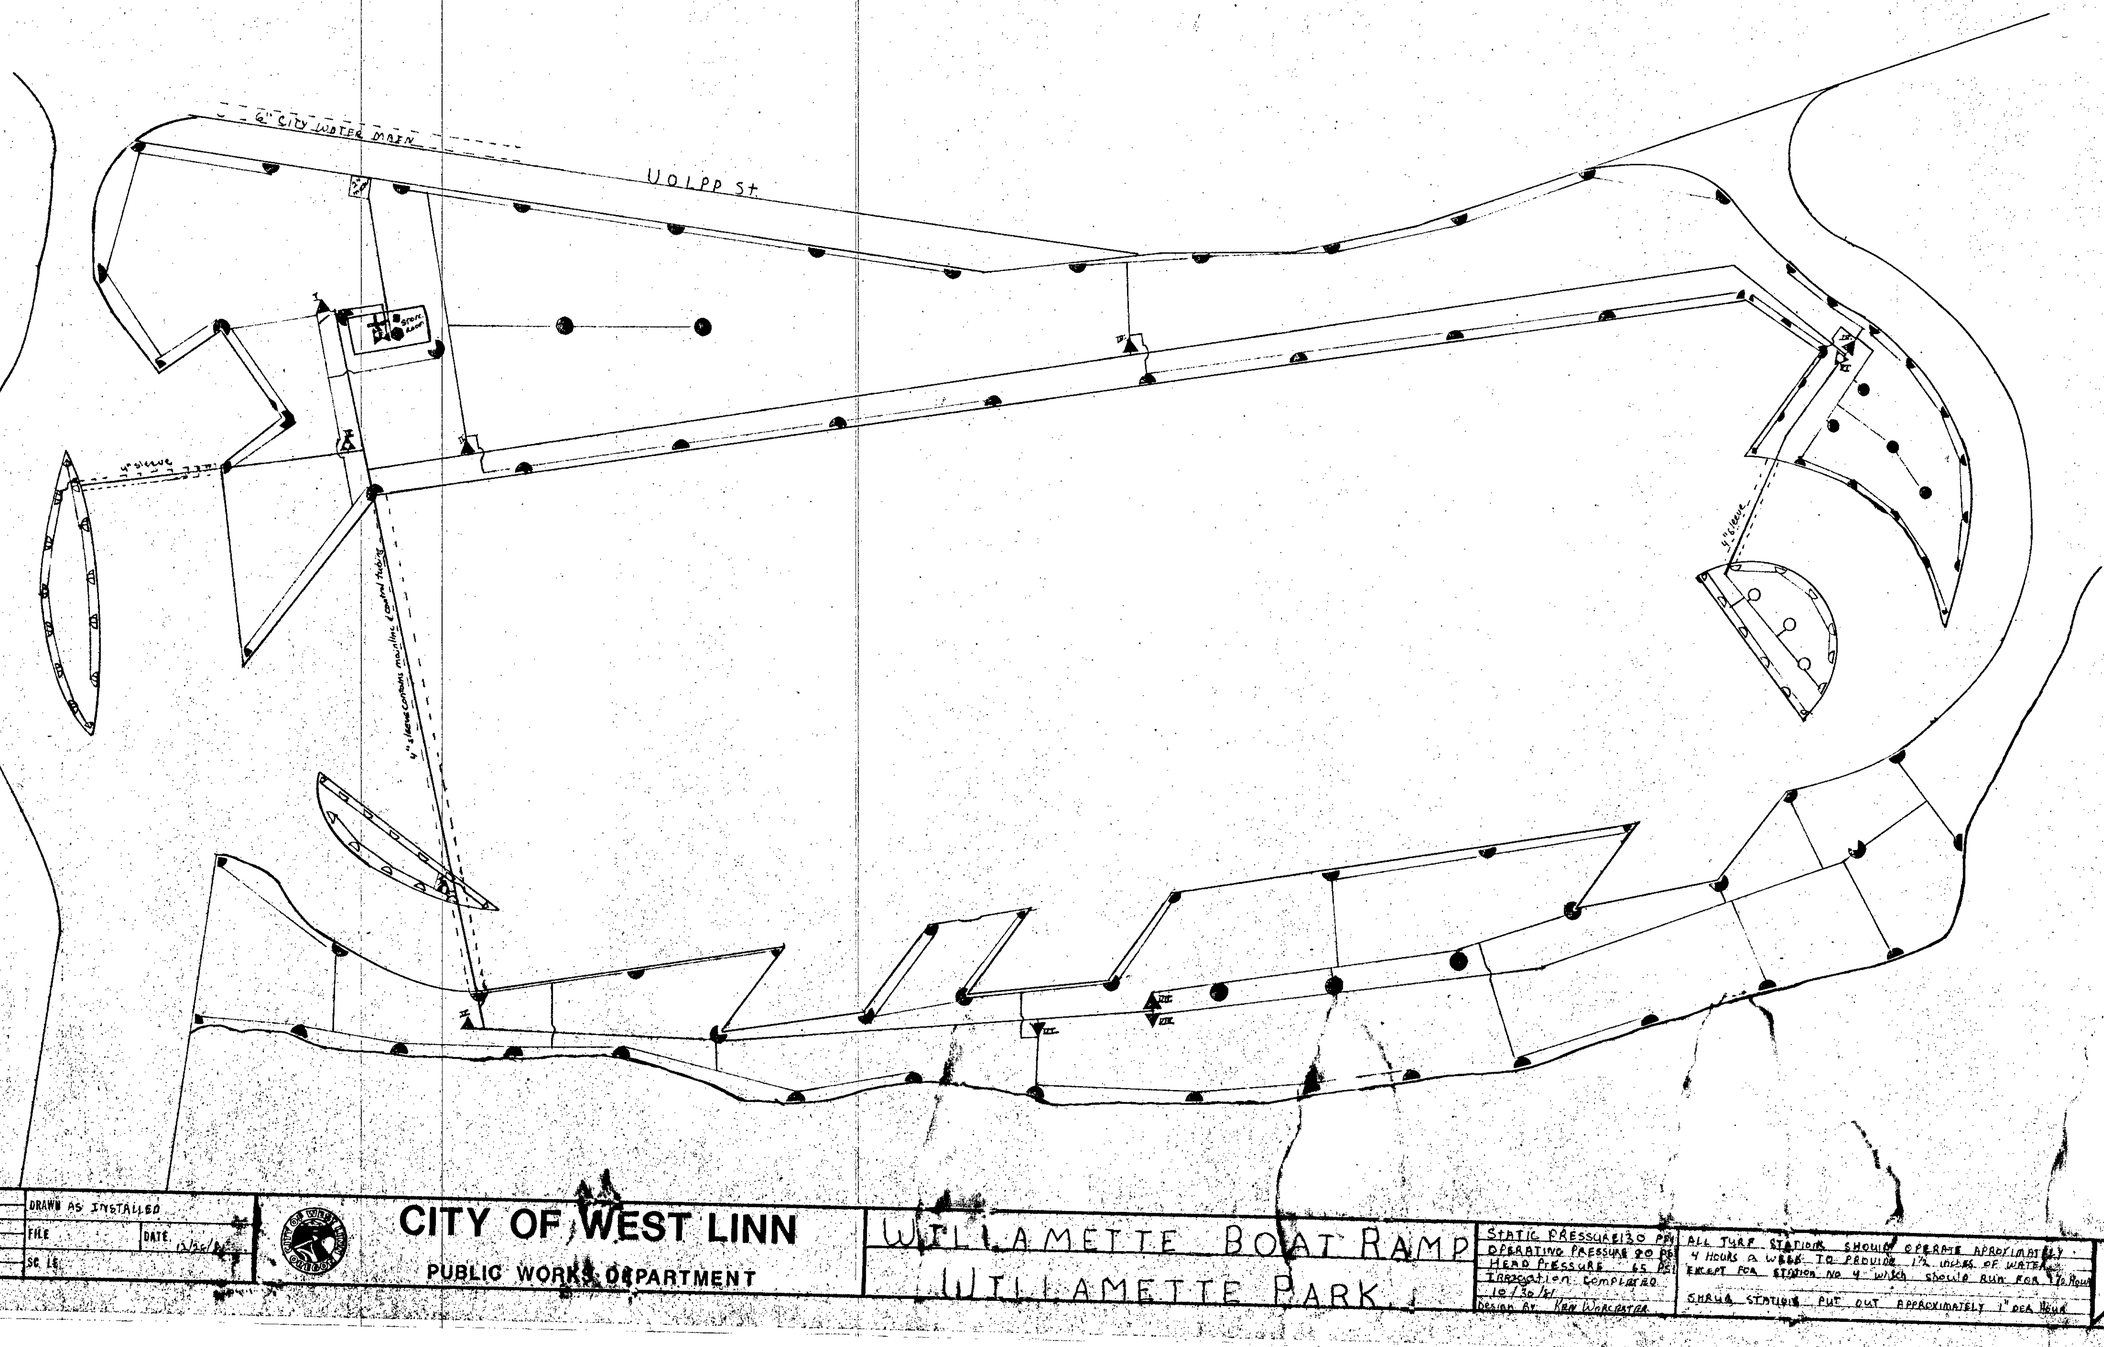
6" CITY WATER MAIN
UOLPP St
Storm Drain
4" sleeve
4" sleeve
4" sleeve

LEGEND

SYMBOL	QTY	PART NO.	TORO PRODUCTS DESCRIPTION
■	9	628-00-24	ADJUSTABLE PART CIRCLE SPRINKLER 9.0Dm
▲	49	628-00-25	ADJUSTABLE PART CIRCLE SPRINKLER 8.0Dm
●	10	628-00-26	ADJUSTABLE PART CIRCLE SPRINKLER 7.9Dm
●	5	624-00-26	FULL CIRCLE SPRINKLER 9.0Dm
◍	13	570-HP-15	12" POP-UP SHRUB HEADS 15' radius
◍	29	570-HP-12	12" POP-UP SHRUB HEADS 12' radius
◍	23	570-P-12	3" POP-UP LAWN HEADS 12' radius
■	1	126-01-11	CUSTOM II Normally OPEN CONTROLLER
⋈	1	- -	FEBCO 1½" PRESSURE VACUUM BREAKER
✚	1	- -	WATTS 1½" PRESSURE REDUCER
●	1	- -	2" gate valve for main shutoff
☢	1	- -	QUICK CONNECT FOR AIR COMPRESSOR
▲	8	232-01-06	1½" NORMALLY OPEN HYDRAULIC VALVE
▲	3	232-01-04	1" NORMALLY OPEN HYDRAULIC VALVE

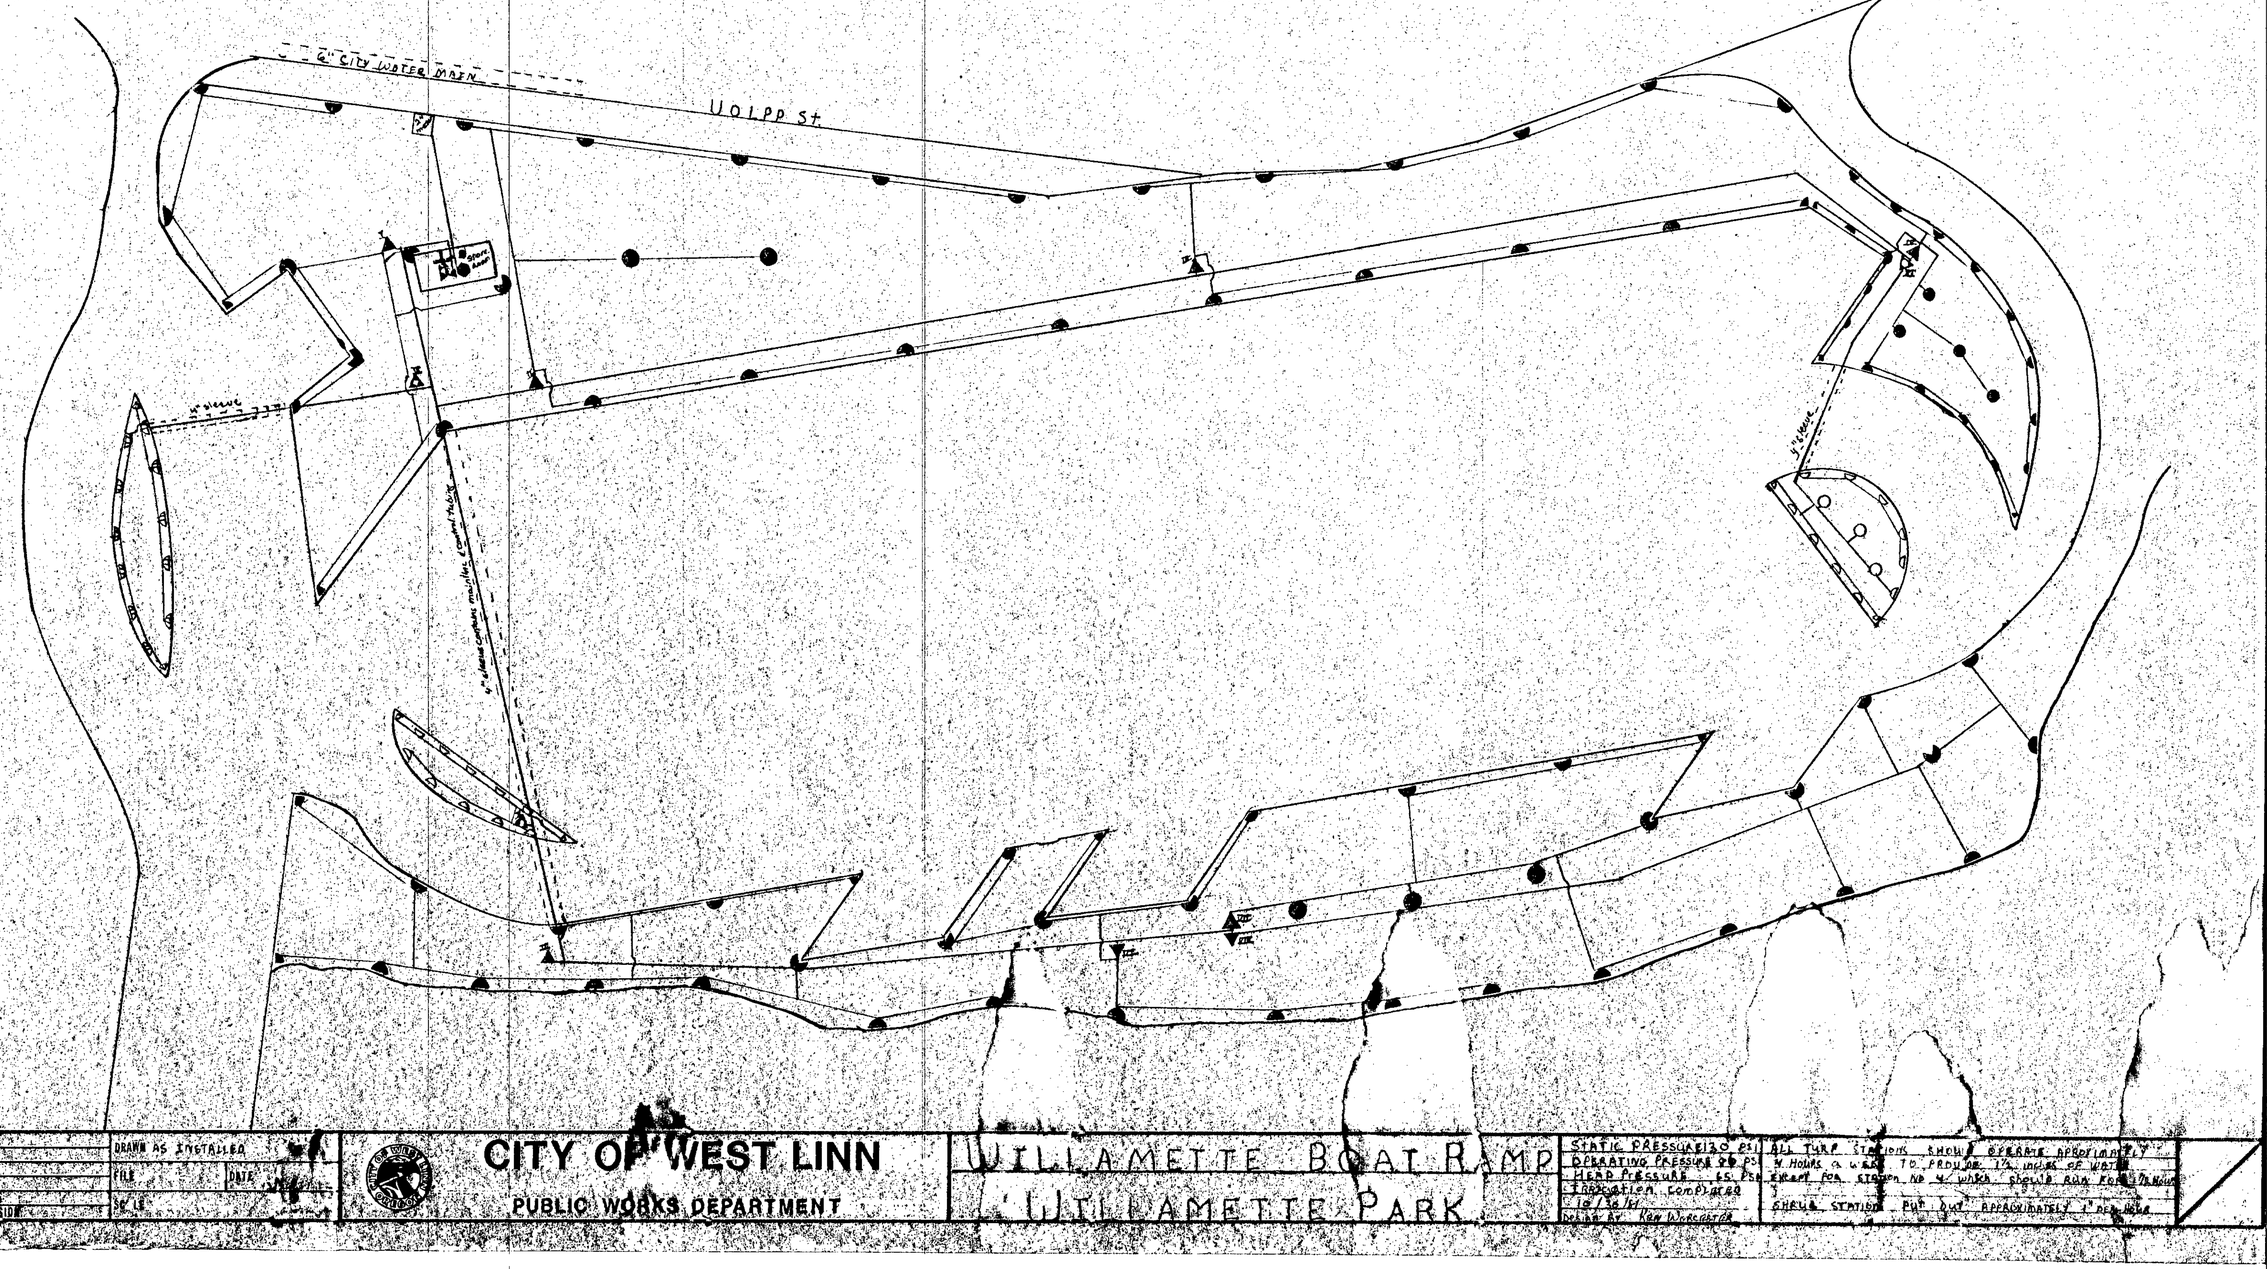

DRAWN AS INSTALLED

FILE: DATE:

SCALE:

CITY OF WEST LINN

PUBLIC WORKS DEPARTMENT

WILLAMETTE BOAT RAMP

WILLAMETTE PARK

STATIC PRESSURE 130 PSI
OPERATING PRESSURE 90 PSI
HEAD PRESSURE 65 PSI
IRRIGATION COMPLETED
10/26/87
DESIGN BY: Ray Worcester

ALL TURF STATIONS SHOULD OPERATE APPROXIMATELY 4 HOURS A WEEK TO PROVIDE 1" inches OF WATER EXCEPT FOR STATION NO 4 WHICH SHOULD RUN FOR 7 HOURS

SHRUB STATIONS RUN ONLY APPROXIMATELY 1 PER WEEK